

2400L ELECTROMAGNETIC DOOR HOLDER, FLUSH WALL MOUNT


WITH LOW PROFILE ARMATURE




DOOR ARMATURE ASSEMBLY

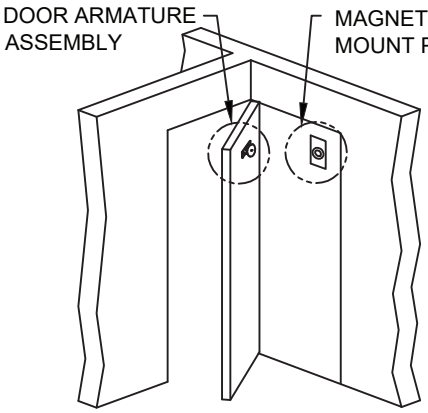

FRONT VIEW

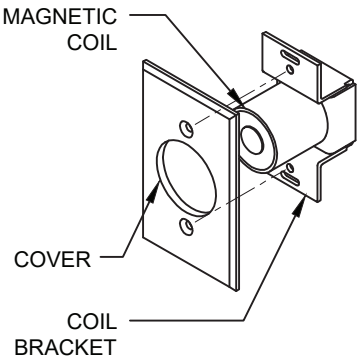

2400L MAGNETIC WALL PORTION

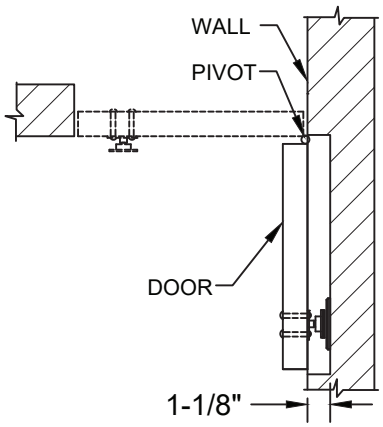


TOP VIEW


ELECTRICAL DATA:

THIS PRODUCT IS AN ELECTROMAGNETIC HOLDING DEVICE, INTENDED FOR USE IN FIRE DOOR APPLICATIONS, BUT CAN BE USED FOR OTHER MAGNETIC APPLICATIONS. WIRE INTO PROPER TERMINALS AS NOTED BELOW:


SERIES	VOLTAGE	DC/mA	DC/VA	AC/mA	AC/VA	TERMINALS
2400L	12 DC	60	.72			Com & 12 v
	24 AC/DC	30	.72	30	.72	Com & 24 v
	120 AC			30	3.60	Com & 120 v




WIRING FOR 120 VAC




WIRING FOR 24 VDC




WIRING FOR 24 VAC



WIRING FOR 12 VDC



CAUTION:
DO NOT LEAVE WIRE EXPOSED

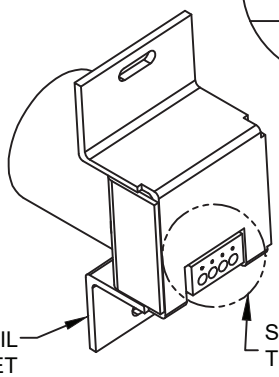

SEE DIAGRAMS TO THE RIGHT FOR APPROPRIATE WIRING

SCREW DETAIL		
	QTY	SCREW
MAGNETIC WALL PORTION	2	6-32 x 1" OVAL HEAD MACHINE SCREW
MAGNETIC COVER	2	6-32 x 1" FLAT HEAD MACHINE SCREW
DOOR ARMATURE	2	10-32 x 1" PAN HEAD MACHINE SCREW
		10-32 x 1-1/4" SNB

2400L-1-04.DWG


ARCHITECTURAL BUILDERS HARDWARE
FAMILY-OWNED SINCE 1991 & MADE IN ITASCA, USA.

ABHMFG.COM
abhinfo@abhmfg.com
630.875.9900

2400L ELECTROMAGNETIC DOOR HOLDER, FLUSH WALL MOUNT

WITH LOW PROFILE ARMATURE


WALL PORTION INSTALLATION:

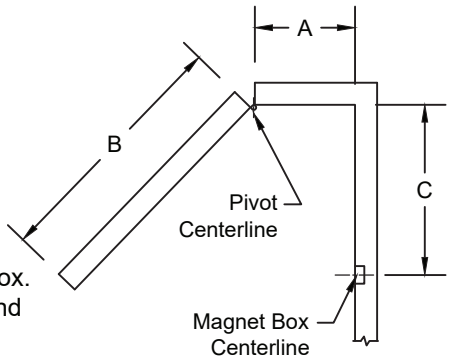

1. Measure distance from pivot centerline to wall (Dim. "A").
2. Determine door width (Dim. "B").
3. Use table below to locate magnet box on wall (Dim. "C").
   a. Example : Dim. "A" = 10" Dim. "B" = 42" Result Dim. "C" = 39".
   b. If Dim. "A" or Dim. "B" Falls between dimensions listed in the table below, allow for difference.
   Example : Dim. "A"= 7" Dim. "B" = 36" Estimated Dim."C" = 33-7/16"
   c. If Dim. "A" and Dim. "B" intersect in the shaded area, **DO NOT INSTALL** magnet box. The degree of door opening will not allow for proper alignment between armature and wall magnet.
4. Suggested vertical location is on top rail approximately 5" from top of the door.
5. Total projection of door hardware must not be more than 1-1/8" on the pull side of door. If greater, you will need to use additional extensions, sold separately.

Dim. "A"	DIM. "B" (DOOR WIDTH)																					
	28		30		32		34		36		38		40		42		44		46		48	
	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg	Dim "C"	Deg
2	25-1/8	93°	27-3/8	93°	29-1/8	93°	31	93°	33-1/8	92°	35-1/8	92°	37-1/8	92°	39-1/8	92°	41-1/4	92°	43-1/8	92°	45-1/4	92°
4	25	98°	27-1/4	97°	29	97°	30-7/8	98°	33	96°	-	-	-	-	-	-	-	-	-	-	-	-
6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
10	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
12	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
14	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
16	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
18	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
20	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
22	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-


6. From corner of wall, measure the appropriate Dim. "C" determined in step 3.
7. Proper electrical wire routing must be done before installing electrical box.
8. The electrical box should be installed with reinforcement to withstand a minimum 50 lb. pull (not provided with unit).

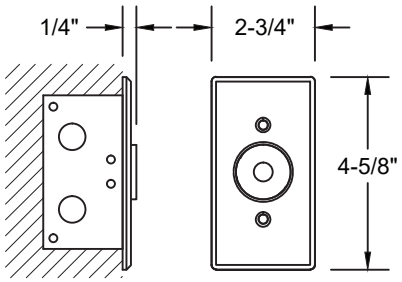

IMPORTANT : a. Check that power voltage equals one of the voltages labeled on back of magnet.
b. Consult " ELECTRICAL DATA" on page 1.

DOOR ARMATURE INSTALLATION:

1. Place and center the door armature on the surface of the magnet with the two holes of the base aligned horizontally.
2. Gently close the door and adjust the angle of the door armature so the base lays flat against the door.
3. While keeping slight pressure on the door, mark location of door armature through the two base holes.
4. Drill through the door where the two marks are located with 5/16" drill. Fasten with the (2)10-32 machine screws & sex bolts provided.

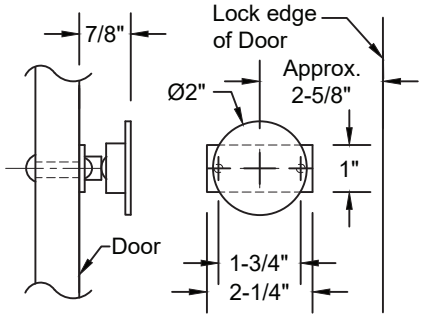

NOTE: All dimensions are provided in inches, unless noted otherwise.

2400L-2-04.DWG